



The Leader in Low-Cost, Remote Monitoring Solutions

Wireless Control



General Description

Monnit wireless control units contain two separate relay switches allowing for individual control through the iMonnit online sensors portal. The control unit relays can be switched on/off manually through the software or automatically by any wireless sensor notification assigned to a single sensor or group of sensors when a specified condition is detected.

Monnit Wireless Control Features

- Allows for automated control
- 10-amp or 30-amp units available
- Two separate relays per unit
- Can be triggered by any Monnit wireless sensor notification to activate upon detection of set conditions
- Can be triggered manually through online monitoring interface
- A/C powered, always on for immediate response from paired sensors.

Applications

- Facilities / Building Operations
- Automated Systems
- Smart Buildings
- Manufacturing Processes
- Machine Control
- Lighting Control
- Sump and Water Evacuation
- Agriculture and Greenhouses

Principle of Operation

The Monnit control unit has two separate relays that can be toggled on/off at will by either: (a) the iMonnit.com web portal; (b) any device that triggers a notification on the same network.

Four LED indicators let the user know if the device is powered on, communicating with the online system and the status of each relay.

The user can manually turn a relay on or off through the iMonnit software. Manual changes are either: (a) temporary based on a set duration (ex. activate the relay for 10 minutes then return to the default state); (b) perpetuated indefinitely until overridden.


Each of the units two relays can also be controlled automatically by any wireless sensor or group of sensors. Automatic relay switching can be triggered by setting the control parameters in a sensor notification from the system. The user can set the default state of each relay to on or off and user defined messages from sensors will cause the relay unit to switch to the non-default state. The relay switches back to its default state when the condition is no longer met.

Example Use: If a water sensor detects water at a certain level in a sump pit, the relay will switch ON, activating the pump. When water is no longer detected, the relay will switch OFF, deactivating the pump motor.

Monnit Wireless Control Unit Specifications

Control Unit Relays	10-Amp Units	30-Amp Units
Initial Contact Resistance	Max. 100 mΩ	Max. 50 mΩ
Max Switching Power (resistive load)	2500VA 150W (NO) 1662VA 150W (NC)	8310VA (30 Amps, 277 VAC)
Max Switching Voltage	250 VAC, 100 VDC (0.5 Amps)	277 VAC
Max Switching Current	10 Amps (AC), 5 Amps (DC)	30 Amps
Nominal Operating Power	360 mW	Approx. 800 mW
Operate Time (at nominal voltage / 20°C)	Max: 10 ms	Max: 20 ms
Release Time (at nominal voltage / 20°C)	Max: 10 ms	Max: 10 ms
Max Operating Speed	20 times/min (at nominal switching capacity)	20 times/min (at nominal switching capacity)
Number of Relays	2 (individually controlled)	
Control Activation	<ul style="list-style-type: none"> • Automatic based on sensor notification settings • Manual through iMonnit online software 	
Power		
Input Power	5.5 VDC @ 900 mA	
Mechanical		
Antenna	Connector: SMA Gain (dBi): 3.0	
Indicator Lights	Four LED indicators <ul style="list-style-type: none"> • Power • Radio (RF) communication • Relay 1 status (On/Off) • Relay 2 status (On/Off) 	
Enclosure	ABS Plastic UL94V-0 flame rating	
Dimensions	5.5 in. x 3.355 in. x 1.25 in. (139.7 mm x 85.217 mm x 31.75 mm)	
Weight	8 ounces	
Environmental		
Operating Temperature	-40°C to +85°C (-40°F to +185°F)	
Certifications:	900 MHz product; FCC ID: ZTL- RFSC1 and IC: 9794A-RFSC1. 868 and 433 MHz product tested and found to comply with: CISPR 22:2008-09 / EN 55022:2010 - Class B and ETSI EN 300 220-2 V2.4.1 (2012-05).	

Note: Monnit control units require a Monnit wireless gateway for operation.

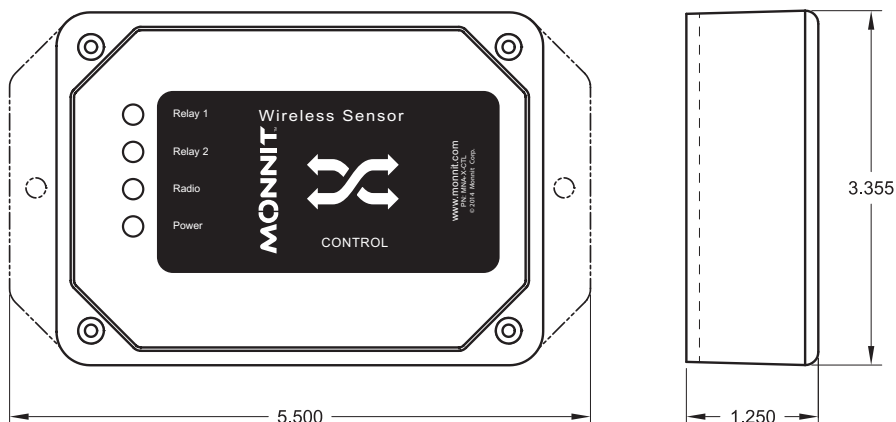

Notes:

Commercial Grade Sensors

Monnit commercial grade sensors are designed for applications in ordinary environments (normal room temperature, humidity and atmospheric pressure). Do not use these sensors under the following conditions as these factors can deteriorate the product characteristics and cause failures and burn-out.

- Corrosive gas or deoxidizing gas - chlorine gas, hydrogen sulfide gas, ammonia gas, sulfuric acid gas, nitric oxides gas, etc.)
- Volatile or flammable gas
- Dusty conditions
- Under low or high pressure
- Wet or excessively humid locations
- Places with salt water, oils chemical liquids or organic solvents
- Where there are excessively strong vibrations
- Other places where similar hazardous conditions exist

Use these products within the specified temperature range. Higher temperature may cause deterioration of the characteristics or the material quality.

