

Technical Information

OneWireless™ Field Device Access Point Specification Release 240 OW03-650-240, October 2015



OneWireless Network Overview

Honeywell OneWireless™ Network is an industrial wireless mesh network capable of simultaneously supporting ISA100 Wireless* (IEC 62734) field instruments (transmitters, actuators, etc.), Wi-Fi devices and Ethernet/IP-based devices. The network is comprised of the following interconnected elements: Honeywell OneWireless Wireless Device Manager (WDM), Honeywell OneWireless Field Device Access Point (FDAP), Cisco* Aironet* 1552S Access Point, and Cisco Wireless Controller. The WDM manages the ISA100 Wireless field instrument network, including ISA100 Wireless field instruments, FDAPs, Cisco Aironet 1552S Access Points with embedded ISA100 Wireless radio, and HART* devices connected wirelessly through the Honeywell OneWireless Adapter.

The FDAP is an industrial meshing access point providing secure and reliable wireless coverage for ISA100 Wireless field instruments only. It uses advanced spatial diversity techniques to mitigate multi-path-induced communication problems found in typical industrial environments, and thereby improve communication reliability and increase effective range.

The FDAP self-discovers and forms an ISA100 Wireless-based wireless mesh network that routes data to and from wireless field instruments and process control applications.

The Cisco Aironet 1552S is an industrial meshing access point that provides secure and reliable wireless coverage for IEEE 802.11b/g/n wireless devices and ISA100 Wireless field instruments. Cisco access points self-discover and form a high-speed IEEE 802.11-based wireless mesh network that routes data to and from wireless clients (e.g., Wi-Fi clients, wired Ethernet devices and wireless field instruments) and process control applications.

The Cisco Wireless Controller provides real-time communications between the 1552S access points in order to simplify the deployment and operation of wireless networks. The controller delivers centralized security policies, Wireless Intrusion



Honeywell's Field Device Access Point (FDAP)

Prevention System (WIPS) capabilities, award-winning RF management, and Quality of Service (QoS) for process data, voice and video.

Product Overview

The FDAP is an industrial meshing access point for ISA100 Wireless field instruments. Once implemented in a plant, it self-discovers other neighboring ISA100 Wireless devices (e.g., Cisco access points, other FDAPs, and ISA100 Wireless field Instruments) to form a reliable and secure ISA100 Wireless-based wireless mesh network. The device can support all ISA100 Wireless field instruments including wired HART instruments connected to the OneWireless Adapter.

The FDAP uses an advanced spatial diversity scheme combined with Honeywell's intelligent wireless algorithm to significantly improve communication reliability in extreme multi-path environments and extend the wireless coverage for ISA100 Wireless field instruments by a factor of 1.5 compared to ISA100 Wireless routing devices without diversity.

Key Benefits

- Provides superior performance in multi-path and non-line-of-sight environments
- Enables use of wireless field instruments for applications requiring fast reporting rates (less than 10 seconds) and short latency (less than 250 mS)
- Optimizes the battery life of a wireless field instrument
- Enables wireless field devices in areas where Wi-Fi radios are not allowed
- Reduces the number of ISA100 Wireless routing devices needed for optimal wireless coverage of ISA100 Wireless field instruments
- Helps reduce operating costs (fewer line-powered routing devices and optimized batteries for wireless field instruments)

Hardware

The FDAP is a 24 VDC- or 120/230 VAC-powered field device featuring an ISA100 Wireless radio with spatial diversity and one Ethernet input for optional connection to a wired network or a wireless access point. Users terminate the power cable and Ethernet cable inside the unit, eliminating the need for a separate enclosure or junction box for termination in hazardous environments.

The FDAP comes in two models: one model certified for Div 2/Zone 2 areas and a second certified for Div 1/Zone 0 areas.

Access Point and Field Router

The FDAP can be used as both an access point and a field router. When connected to a wired backbone such as a Local Area Network (LAN) via an Ethernet port, the FDAP acts as an access point and will route ISA100 Wireless traffic via the Ethernet connection to the WDM. When installed as a router in the field but not connected to a wired backbone, the FDAP acts as a repeater and will route ISA100 Wireless traffic to another routing field device.

Self-Configuring and Self-Healing Mesh

As previously stated, the FDAP self-discovers other neighboring ISA100 Wireless devices to form a reliable and secure ISA100 Wireless-based wireless mesh network. Honeywell's intelligent wireless routing algorithm enables the FDAP to identify the best route to send data to and from wireless field instruments. This algorithm optimizes the field instrument mesh network when FDAPs are added to, or removed from the network.

The FDAP radio operates in the license-free 2.4 GHz ISM band using the ISA100 Wireless radio, which is a standard-based IEEE 802.15.4 radio.

Robust Embedded Security for ISA100 Communications

Security is a primary concern for the process automation community. To mitigate security threats, ISA100 Wireless requires all process data to be AES-128-bit encrypted. The data is encrypted and decrypted at the field I/O device and WDM level to provide end-to-end security for the process data.

In addition to data encryption, the ISA100 Wireless standard requires each wireless field device to be authenticated before joining the network. The ISA100 Wireless standard supports two types of authentication key distribution: over-the-air and infrared. The infrared authentication key distribution method adds another layer of security as it requires users to be physically next to the wireless field instrument to add it to the network. The FDAP supports both authentication key distribution methods.

The authentication keys are managed by the WDM. A handheld device is used when opting for the infrared authentication key distribution. The handheld uploads the authentication keys from the WDM and downloads keys to field devices using short-range infrared communication. The FDAP features a conveniently located IR port for use in device commissioning. Once a key is deployed to an ISA100 Wireless field device, including the FDAP, it is validated by the WDM before the ISA100 Wireless field device can join the ISA100 Wireless network. Key deployment is a one-time activity, which means that devices can re-join the network after power-down or other service interruptions without re-keying the device.

Remote and Local Configuration

FDAPs require little configuration. All configuration parameters are easily accessible from the WDM, which centralizes all key functions required to manage the field instrument network and wireless field devices.

Lightning Surge Arrestors and Antenna Selection


FDAPs come with the choice of integral and remote surge arrestors as well as integral and remote antennas. The antenna selection includes integrated omni-directional antennas and remote-mounted, high-gain, directional and omni-directional antennas. The FDAP supports a variety of high- and low-gain directional antennas to provide flexibility in installation and maximum performance of the wireless system.

Hardware Specifications

Model Numbers	FDAP1 (Class 1 Div 1 / Zone 0) FDAP2 (Class 1 Div 2 / Zone 2)
Multiple Standards / Field Protocols	ISA100 Wireless
Weight	3.86 kg (5.5 lbs)
Dimensions	216 x 170 x 86 mm (8.47 x 6.73 x 3.37 in)
Power	FDAP1: 18-30 VDC at 2 Watts FDAP2 ¹ : 18-30 VDC at 2 Watts / 90-264 VAC, 50/60 Hz
External Ports and Connections	2 X external antenna ports for 2.4 GHz ISA100 Wireless field instruments
Internal Connections	1 X 10/100 Mbps auto-negotiation Ethernet port 1 X shielded power cable 1 X grounding cable
Environmental Ratings	IP66, NEMA Type 4X, G3 corrosion resistance per ANSI/ISA-S71.04-1985
Operating Temperature	FDAP1: -40 to +75° C (FM) -40 to +70° C (IECEX) FDAP2: -40 to +70° C (FM) -40 to +70° C (IECEX) -40 to +70° C (ATEX)
Transportation and Storage Temperature	-40 to +85° C
Operating Humidity	0~100% non-condensing
Transportation and Storage Humidity	0~100% non-condensing
Mechanical Shock	4G
Data Rates and Modulations	Radio: 250 Kbps, DSSS/O-QPSK Wire: 10 / 100 Mbps Fast Ethernet
Frequency Band and Operating Channels	Unlicensed ISM Band (2.4 – 2.483 GHz) 13 DSSS channels for ISA100 Wireless
Compliance	Radio Approvals FCC Part 15.247 Subparts B and C Canada – Industry Canada Method RSS-210, Issue 7 RSS-Gen, Issue 2 ICES-003, Issue 4 Australia and New Zealand – ACMA AS NZS 4268-2008 European Union – ETSI EN 300 328 V1.8.1 EN 301 489-17 V2.2.1 EN 301 489-1 V1.9.2

	<p>IEC61326-1, 2006</p> <p>CE Mark</p> <p>R&TTE Directive 1999 / 5 / EC</p> <p>EMC Directive 2004 / 108 / EC</p> <p>LVD Directive 73 / 23 / EEC</p> <p>ATEX Directive 94 / 9 / EC</p> <p>Hazardous Environment Ratings</p> <p><i>FDAP1 Model:</i></p> <p>FM: Class I, Division 1 Group C, D / Zone 0 Group IIB T4</p> <p>IECEX: Ex ia IIB Ga T4</p> <p>ATEX: Pending</p> <p><i>FDAP2 Model:</i></p> <p>FM: Class I, Division 2 Group A, B, C, D / Zone 2 Group IIC T4</p> <p>IECEX: Ex nA nC [ic] IIC T4 Gc</p> <p>ATEX: II 3G Ex nA nC [ic] IIC T4 Gc</p>
Security	128-bit AES encryption
Quality of Service	Supported
Transmit Power (Maximum)	18 dBm
Receive Sensitivity (Typical)	-95 dBm @ 250 kbps
Network Interface	10/100 Mbps Ethernet, auto-sensing
Number of Supported Honeywell OneWireless XYR™ 6000 Field Instruments	<p><i>FDAP as an access point (connected to a high-speed backbone¹):</i></p> <p>18 ISA100 Wireless Field Instruments at 1 second reporting rate</p> <p>60 ISA100 Wireless Field Instruments at 5 seconds or greater reporting rate</p> <p><i>FDAP as a router (routing data to another ISA100 device):</i></p> <p>10 ISA100 Wireless Field Instruments at 1 second reporting rate</p> <p>20 ISA100 Wireless Field Instruments at 5 seconds or more reporting rate</p>
Number of Supported Enraf FlexLine Radar Gauges / Wireless Field Interface (WFI)	<p><i>FDAP as an access point (connected to a high-speed backbone^{1,3}):</i></p> <p>13 Enraf FlexLine Radar Gauges / WFI</p> <p><i>FDAP as a router (routing data to another ISA100 device):</i></p> <p>10 Honeywell Enraf FlexLine Radar Gauges / WFI with 1 second publication rate with input only channels</p> <p>5 devices with 1 second publication rate with both input and output channels</p>
Number of Supported SKF WVT Field Devices	<p><i>FDAP as an access point (connected to a high-speed backbone¹):</i></p> <p>15 Wireless Vibration Transmitter (WVT) Field Devices</p> <p><i>FDAP as a router (routing data to another ISA100 device):</i></p> <p>10 Wireless Vibration Transmitter (WVT) Field Devices</p>
Maximum Number of Wireless Network Hops Between an Access Point and a Field Device	4 Hops
Warranty	1 Year
ECCN	5A002 ENC

Technical Drawing

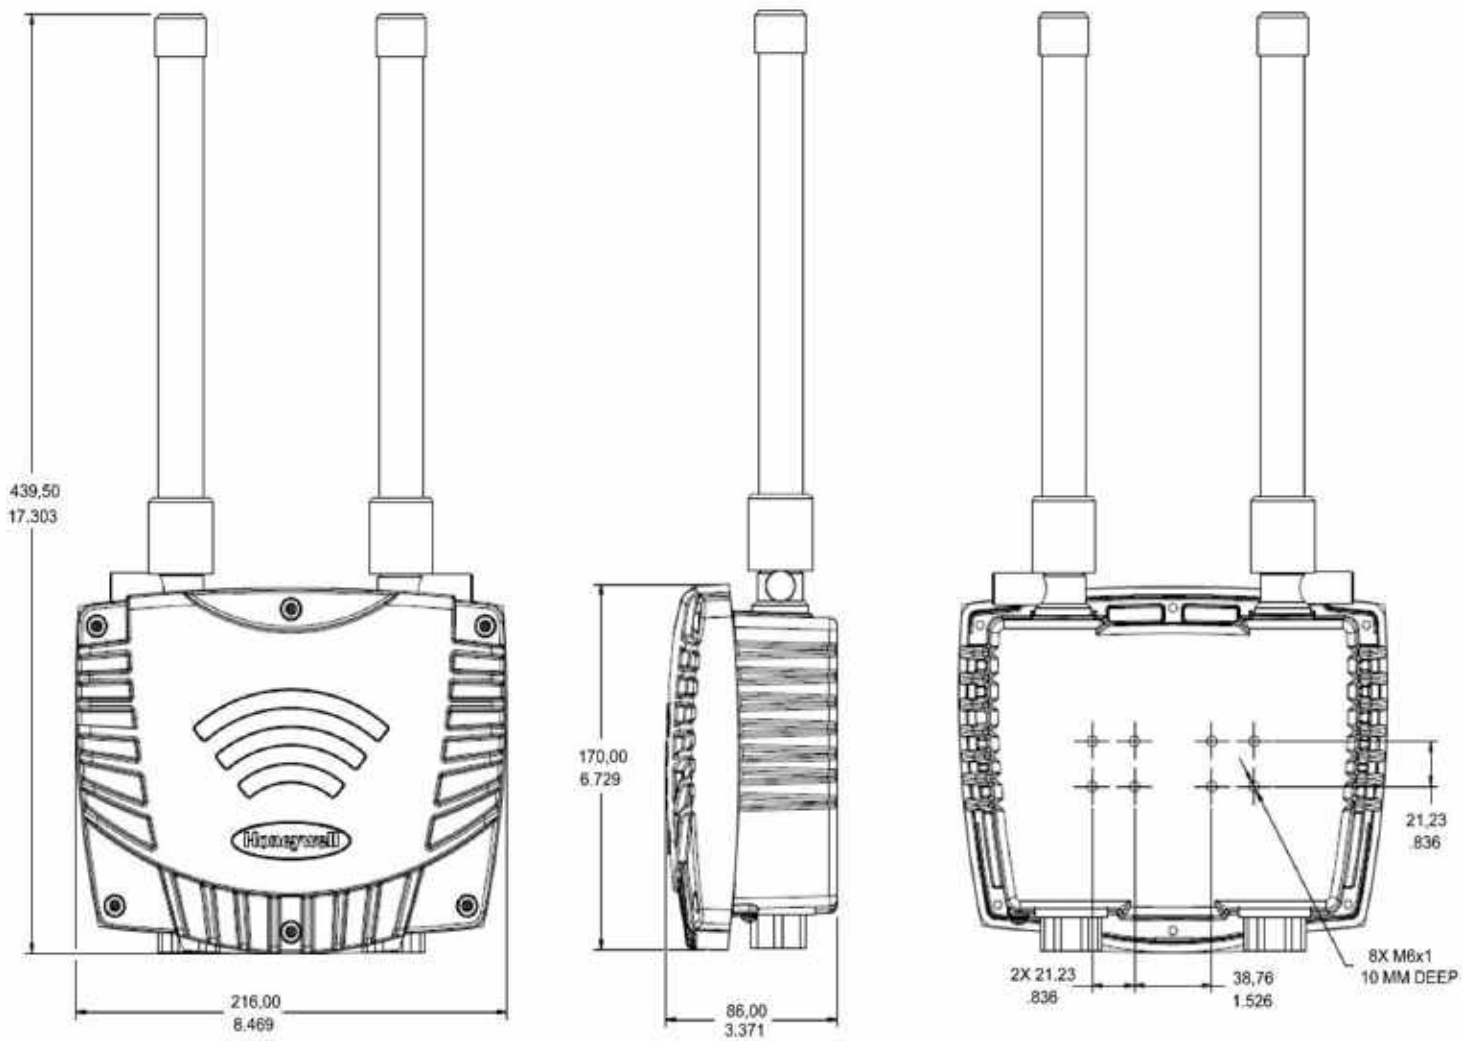

Model Selection Guide

¹ No external power converter required when used with AC power input

² Field Instruments with input channels only

³ These limits are for applications using Enraf Interface protocol tunnel. When Enraf Interface protocol tunnel is disabled, capacity limits as specified for XYR6000 apply.



Section 13
Page: WNM-11
Effective Date: January 1, 2014

OneWireless Field Device Access Point

Model Selection Guide with Price Data

Model Selection Guide
34-XY-16-92 Issue 4

Honeywell Proprietary



Instructions

<ul style="list-style-type: none"> Select the desired key number. The arrow to the right marks the selection available. Make one selection from Table I. Select Table II options as desired. 	List Price equals the sum of all prices for all selections made.
Key Number I II III IV V [] - [] - [] - [] - [] - []	

KEY NUMBER

Description	Part Number	Selection	Avail.
Field Device Access Point with Class 1 Div 2 certification (i.e. 24VDC and 120/230V AC power input)	51198665-200	FDAP2	•
Field Device Access Point with Class 1 Div 1 certification (24VDC power input)	51198665-100	FDAP1	•

TABLE I - DSSS Antenna 1 Options

Description	Part Number	Selection	Avail.
None	N/A	F0	•
5 dBi Integral Omni	51506534-101	F1	•
6 dBi Integral Omni	51198667-100	F6	•
8 dBi Remote Omni	50018414-001	F8	•
with No Integral Lightning Surge Arrestor	N/A	00	•
with Integral Lightning Surge Arrestor	51202383-200	SA	•
with Remote Lightning Surge Arrestor	51202359-100	RS	•
No Cable	N/A	00	•
1 m (3.2 ft) Cable	50018278-001	01	•
3 m (9.8 ft) Cable	50018278-003	03	•
10 m (32 ft) Cable	50018278-010	10	•

TABLE II - DSSS Antenna 2 Options

Description	Part Number	Selection	Avail.
None	N/A	F0	•
5 dBi Integral Omni	51506534-101	F1	•
6 dBi Integral Omni	51198667-100	F6	•
8 dBi Remote Omni	50018414-001	F8	•
with No Integral Lightning Surge Arrestor	N/A	00	•
with Integral Lightning Surge Arrestor	51202383-200	SA	•
with Remote Lightning Surge Arrestor	51202359-100	RS	•
No Cable	N/A	00	•
1 m (3.2 ft) Cable	50018278-001	01	•
3 m (9.8 ft) Cable	50018278-003	03	•
10 m (32 ft) Cable	50018278-010	10	•

TABLE III - Options

Description	Part Number	Selection	Avail.
None	N/A	00	•
Wall mount kit	51202381-501	WM	•
Pole mount kit for 6.35 cm (2 1/2") max diameter pole	51196557-502	PM	•

TABLE IV - Documentation

Description	Part Number	Selection	Avail.
OneWireless Network R200 Electronic Documentation on a CD	51153920-001	DD	•

TABLE V

Description	Part Number	Selection	Avail.
Factory Use		0000	•

NOTES:

- No power supply required
- Electronic Documentation is mandatory

XYR™ and OneWireless™ are trademarks of Honeywell International Inc.

*All other products and brand names shown are trademarks of their respective owners.

While this information is presented in good faith and believed to be accurate, Honeywell disclaims the implied warranties of merchantability and fitness for a particular purpose, and makes no express warranties except as may be stated in its written agreement with and for its customer. In no event is Honeywell liable to anyone for any indirect, special or consequential damages. The information and specifications in this document are subject to change without notice.

This document is published for the sole usage of Honeywell Process Solutions customers and prospective customers.

For More Information

To learn more about Honeywell's OneWireless solutions, visit our website www.honeywellprocess.com or contact your Honeywell account manager.

Honeywell Process Solutions

Honeywell
1250 West Sam Houston Parkway South
Houston, TX 77042

Honeywell Control Systems Ltd
Honeywell House Skimped Hill Lane Bracknell
RG12 1EB

Shanghai City Centre, 100 Junyi Road
Shanghai, China 20051

www.honeywellprocess.com

OW03-650-240
October 2015
© 2015 Honeywell International Inc.

The Honeywell logo is displayed in a bold, red, sans-serif font.